




TR712

排風口在玻璃
Exhaust outlet on the glass

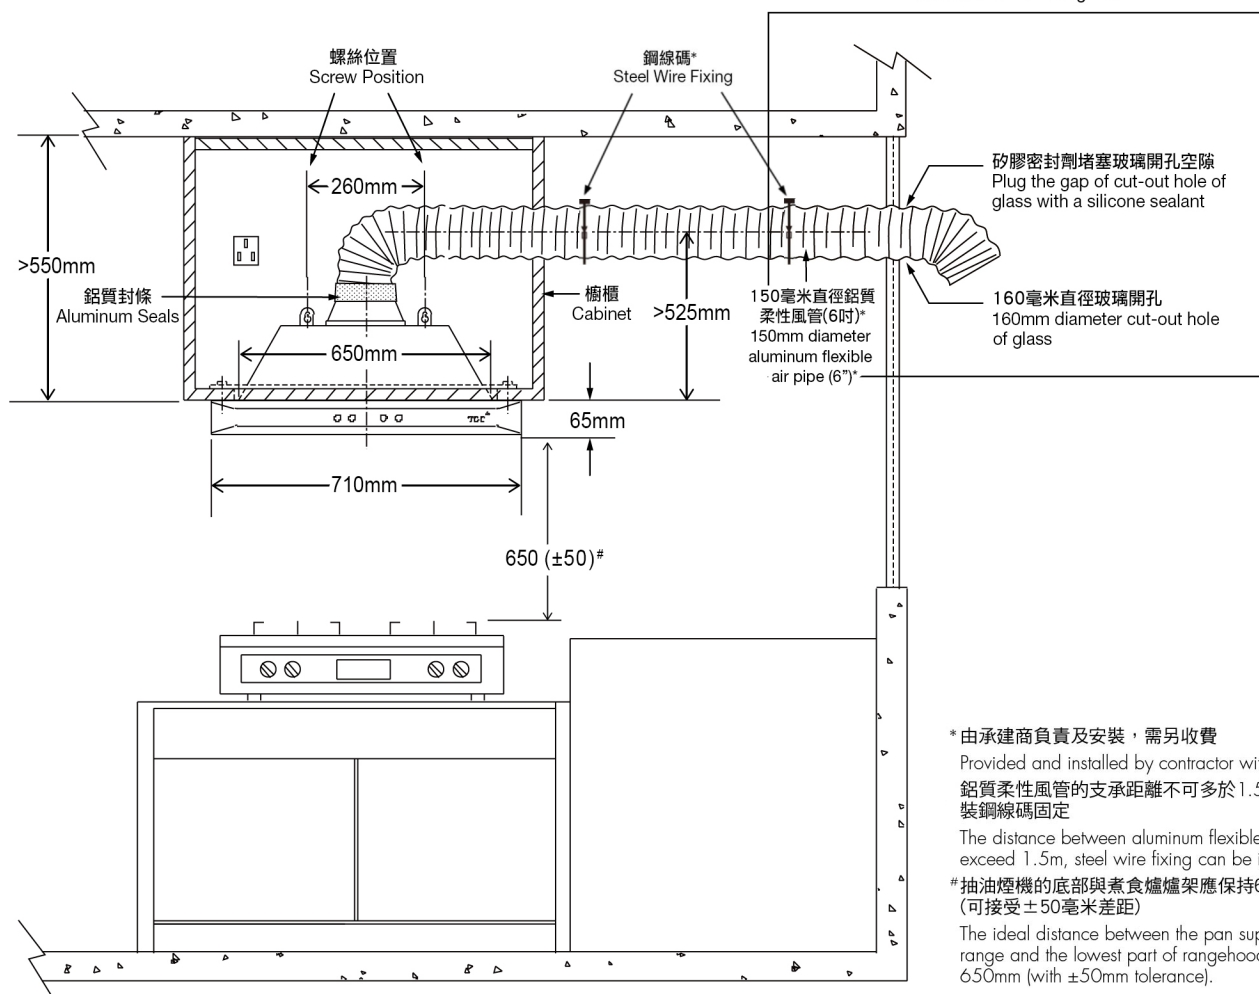

*由承建商負責及安裝，需另收費


Provided and installed by contractor with additional charge
鋁質柔性風管的支承距離不可多於1.5米，如有需要可加裝鋼線碼固定

The distance between aluminum flexible air pipe cannot exceed 1.5m, steel wire fixing can be installed as required


[#]抽油煙機的底部與煮食爐架應保持650毫米距離 (可接受 ± 50 毫米差距)

The ideal distance between the pan support of cooking range and the lowest part of rangehood should be 650mm (with $\pm 50\text{mm}$ tolerance).

正視圖
Front View

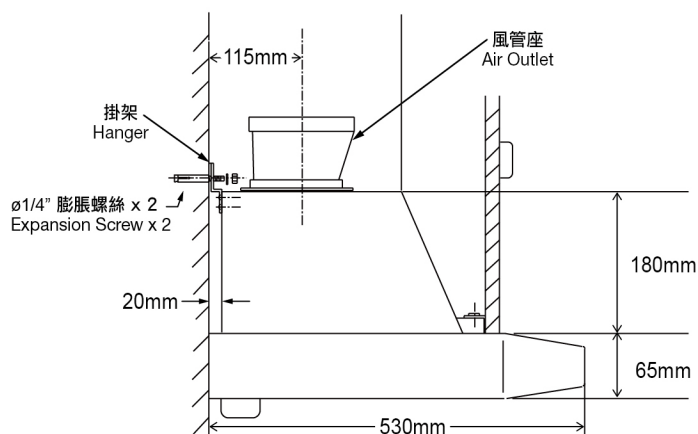

側視圖
Side View

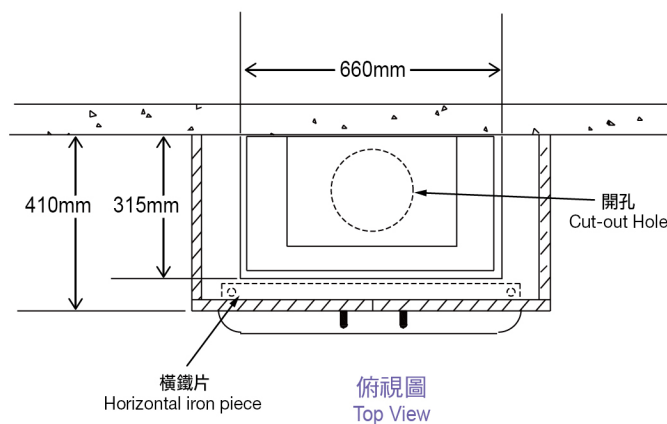

俯視圖
Top View

mm = 毫米



煤氣
Towngas